

PROVIDE KICK PLATE ON PUSH SIDE

DOOR SCHEDULE											
DOOR NO.	TYPE	OPENING SIZE		DOOR MATERIAL	FRAME MATERIAL	HDW.	DETAILS			U.L. LABEL	REMARKS
		WIDTH	HEIGHT				HEAD	JAMB	SILL		
①	III	PR 3'-0"	7'-0"	D2	F2	H1 EACH	1 AD1.1	2 AD1.1	3 AD1.1	—	24"x36" WINDOW
②	IV	3'-0"	7'-0"	D2	F2	H1	1 AD1.1	2 AD1.1	3 AD1.1	—	24"x36" WINDOW
③	III	PR 3'-0"	7'-0"	D2	F2	H1 EACH	1 AD1.1	2 AD1.1	3 AD1.1	—	24"x36" WINDOW
④	IV	3'-0"	7'-0"	D1	F1	H2	4 AD1.1	4 AD1.1	5 AD1.1	—	24"x36" WINDOW
⑤	V	PR 3'-0"	7'-0"	D1	F1	H3 EACH	4 AD1.1	4 AD1.1	5 AD1.1	1 1/2	4"x24" WINDOW
⑥	I	3'-0"	7'-0"	D1	F1	H4	4 AD1.1	4 AD1.1	5 AD1.1	—	24"x36" WINDOW
➤ ⑦	IV	3'-0"	7'-0"	D1	F1	H2	4 AD1.1	4 AD1.1	5 AD1.1	—	24"x36" WINDOW
⑧	II	3'-0"	7'-0"	D1	F1	H3	4 AD1.1	4 AD1.1	5 AD1.1	1 1/2	4"x24" WINDOW

DOOR MATERIAL

- D1 SOLID CORE WOOD  
D2 INSULATED 18 GA. HOLLOW METAL DOOR WITH 1/4" SAFETY GLAZING PER SCHEDULE

FRAME MATERIAL

- F1 18 GA. x 1 1/2" PREFINISHED HOLLOW METAL FRAME  
F2 16 GA. HOLLOW METAL DOOR FRAME, EXTERIOR

DOOR GENERAL NOTES

- ALL EXITS ARE TO BE OPENABLE FROM INSIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE.
- ALL DOOR HARDWARE TO COMPLY WITH A.D.A. REQUIREMENTS.
- FOR ALL DOORS VERIFY LOCKING FUNCTIONS AND MASTER KEYING WITH OWNER PRIOR TO INSTALLATION.
- FOR ACCESSIBILITY REQUIREMENTS SEE ACCESSIBILITY SHEETS
- 1 1/2 HOUR FIRE RATED DOORS SHALL HAVE WIRED GLASS OR FIRE PROTECTION RATED GLAZING PER NFPA 80.
- ALL GLAZING IN DOORS AND WINDOWS SHALL BE TEMPERED SAFETY GLAZING
- FIRE RESISTANCE ASSEMBLIES FOR PROTECTION OF OPENING TO COMPLY WITH CBC SECTION 715

HARDWARE SCHEDULE

GROUP #1	GROUP #2	GROUP #3	GROUP #4
1 PANIC HARDWARE 1 1/2 PR. BUTTS, 4 1/2x4 1/2 1 CLOSER 1 STOP 1 SET WEATHER STRIP'NG 1 THRESHOLD 1 AUTO DOOR BOTTOM	1 LOCKSET, LEVER HANDLE 1 1/2 PR. BUTTS, 4 1/2x4 1/2 1 CLOSER 1 STOP	1 PANIC HARDWARE 1 1/2 PR. BUTTS, 4 1/2x4 1/2 1 CLOSER 1 STOP 1 SET SMOKE SEALS 1 AUTO DOOR BOTTOM	1 PRIVACY LOCK, LEVER HANDLE 1 1/2 PR. BUTTS, 4 1/2x4 1/2 1 CLOSER 1 KICK PLATE ON PUSH SIDE ONLY

The approved height in RFI #66 was 4' 0". Confirm that 3' 4" meets code.

This width was approved in RFI #116

WINDOW SCHEDULE											
WDW. NO.	TYPE	OPENING SIZE		GLAZING MATERIAL	FRAME MATERIAL	DETAILS			U.L. LABEL	QUANTITY	REMARKS
		WIDTH	HEIGHT			HEAD	JAMB	SILL			
A	I	11'-3"	3'-4"	G1	F1	6 AD1.1	7 AD1.1	8 AD1.1	-	1	
B	I	22'-6"	3'-4"	G1	F1	6 AD1.1	7 AD1.1	8 AD1.1	-	1	
C	II	2'-6"	3'-4"	G1	F1	6 AD1.1	7 AD1.1	8 AD1.1	-	1	
D	I	7'-6"	3'-4"	G1	F1	6 AD1.1	7 AD1.1	8 AD1.1	-	1	
E	I	7'-6"	3'-4"	G2	F1	9 AD1.1	9 AD1.1	10 AD1.1	1 1/2 HOUR	1	WITH 2 HOUR FIRE SHUTTERS MOUNTED INSIDE CONTROL ROOM
F	I	7'-6"	3'-4"	G2	F1	9 AD1.1	9 AD1.1	10 AD1.1	1 1/2 HOUR	1	WITH 2 HOUR FIRE SHUTTERS MOUNTED INSIDE CONTROL ROOM

SEE NOTES SHEET AD1.1

WINDOW KEYNOTES

WINDOW MATERIAL


- G1 1" INSULATED GLASS WITH PPG SUPER GREY TINTED OUTER LITE AND INNER LITE CLEAR WITH LOW-E FILM ON THIRD SURFACE  
G2 1/4" GLAZING

FRAME MATERIAL

- F1 METAL FRAME PER PEMB SUPPLIER

ALUMINUM FRAME

WINDOW TYPES

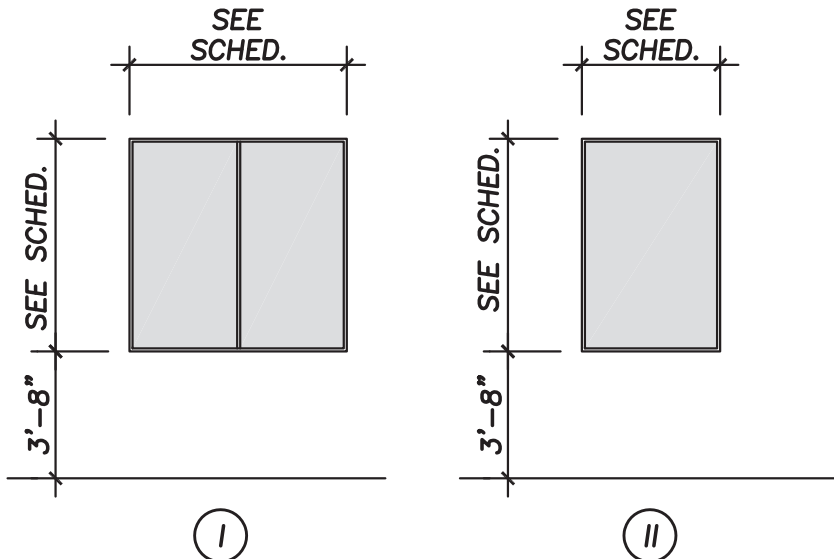

FINISH SCHEDULE

ROOM NO.	ROOM NAME	FLOOR	BASE				WALL FINISH				WALL COVER.				CEILING		REMARKS
			N	E	S	W	N	E	S	W	N	E	S	W	HT.	FIN.	
201	CONTROL ROOM	F1	B2	B2	B2	B2	W1	W1	W1	W1	WC1	WC1	WC1	WC1	9'-0"	C1	NOTE 1
202	DCS ROOM	F1	B2	B2	B2	B2	W1	W1	W1	W1	WC1	WC1	WC1	WC1	9'-0"	C1	NOTE 1
203	COMMUNICATIONS	F1	B2	B2	B2	B2	W1	W1	W1	W1	WC1	WC1	WC1	WC1	9'-0"	C1	NOTE 1
204	BREAK ROOM	F2	B2	B2	B2	B2	W2	W2	W1	W2	WC3	WC3	WC3	WC3	9'-0"	C1	
205	UNISEX RESTROOM	F3	B1	B1	B1	B1	W2	W2	W1	W2	WC2	WC2	WC3	WC2	9'-0"	C2	

NOTE 1 "TATE" ACCESS FLOOR "CONCORE 1250" 24" SQUARE GRID. SEE DETAIL 5/AD1.2

FINISH SCHEDULE KEYNOTES

FLOOR FINISH

- F1 VINYL COMPOSITION STATIC DISSIPATIVE TILES  
F2 VINYL COMPOSITION TILES  
F3 2" CERAMIC TILE

WALL BASE

- B1 COVED CERAMIC TILE TO MATCH FLOOR TILE  
B2 4" RUBBER TOP SET

WALL FINISH

- W1 5/8" GYPSUM BOARD, FINISH AND PAINT PER SPECIFICATIONS  
W2 5/8" WATER RESISTANT GYPSUM BOARD, PAINT AND FINISH PER SPECIFICATIONS

WALL COVERING

- WC1 NONE  
WC2 CERAMIC TILE, FULL HEIGHT  
WC3 CERAMIC TILE, 48" HIGH

CEILING

- C1 SUSPENDED CEILING WITH ACOUSTICAL PANELS PER SPECIFICATIONS  
C2 5/8" GYPSUM BOARD CEILING, TAPED, TOPPED, SANDED SMOOTH AND PAINTED PER SPECIFICATIONS

FINSH GENERAL NOTES

- INTERIOR WALL AND CEILING MATERIALS SHALL NOT EXCEED THE FLAME SPREAD CLASSIFICATIONS IN 2010 CBC SECTION 804, TABLES 8-A & 8-B
- ALL PAINT FINISHES TO HAVE 1 PRIMER COAT AND 2 FINISH COATS
- ALL DRAPES, HANGING CURTAINS AND ALL OTHER DECORATIVE MATERIALS TO COMPLY WITH FIRE CODE SECTION 1103.3.3
- ALL INTERIOR ARCHITECTURAL PAINTS, COATINGS AND PRIMERS AS WELL AS ANTI-CORROSIVE AND ANTI-RUST PAINTS, CLEAR WOOD FINISHES, FLOOR COATINGS, STAINS AND SHELLACs SHALL MEET LEED FOR NEW CONSTRUCTION VERSION 2.2 REQUIREMENTS

A	100% SUBMITTAL	BP	JM	-	11.30.11
REV	DESCRIPTION	DWN	CHK	APP	DATE

LOS ANGELES  
DEPARTMENT OF WATER AND POWER

HAYNES GENERATING STATION  
UNITS 11-16



Kiewit Power  
3401 Warner Boulevard  
Lawrence, Kansas 66219

STRUCTURAL ENGINEERS:

J. MILCZEWSKY  
and ASSOCIATES

3275 E. DATE ST.  
BREA, CA. 92823

(714) 335-1289 BUS  
(714) 494-8012 FAX

JOB NUMBER 10-048

CONTROL BUILDING  
SCHEDULES



DWP DRAWING NUMBER

DESIGNED -  
DRAWN BAP  
CHECKED JAM  
APPROVED -

DRAWING NUMBER

A7.1